
## **DIN-Rail Interface Enclosures**

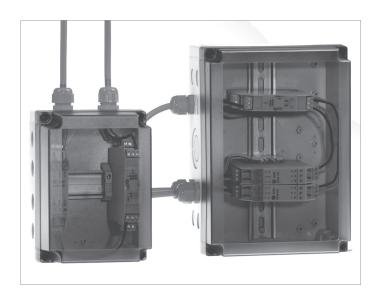

Product overview	
Product Type	DIN-Rail Interface Enclosures
Part No.	29600-239 (Enclosure on the left) 29600-240 (Enclosure on the right)

## **Application**

Apollo has two DIN-rail interface enclosures in its range of accessories. The enclosures can be used for housing intrinsically safe (I.S.) barriers, XP95 or Soteria DIN-rail mounted interfaces.


The IP67 rated enclosures have a frosted polycarbonate lid through which LEDs can be viewed. A multi-purpose label that features a section for use with I.S. systems is supplied. For non-I.S. systems, the part referring to I.S. can simply be removed.


## Intrinsically safe circuits

When using these enclosures with intrinsically safe systems, it is important that segregation be provided between the I.S. and non-I.S. circuits. A distance of at least 50mm must be preserved between live conducting parts of I.S. and other circuits.

If the enclosure is used as part of an I.S. circuit, then it must always be installed inside the safe area. Never install these enclosures in the hazardous area.

Please refer to Figures 1, 2 & 3 for more information on how to configure units.

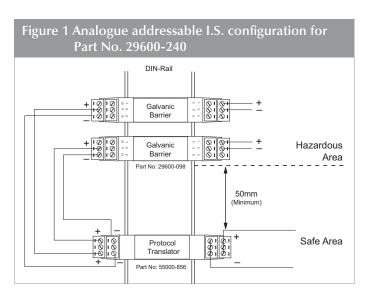

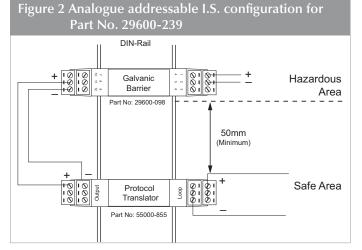

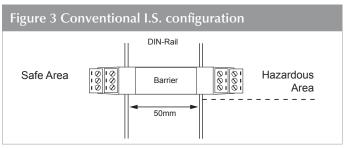


Table 1 DIN-Rail Interface Enclosure Capacity								
Part Number	Dimensions	20mm cable entries	Maximum Capacity					
	H x W x D (mm)		Soteria large DIN-Rail	Soteria small DIN-Rail	XP95 DIN-Rail	Conventional I.S. DIN-Rail	Addressable I.S. DIN-Rail	
29600-239	150 x 125 x 180	12 (drillable)	1	2	4	2*	1 safety barrier & 1 x translator*	
29600-240	150 x 180 x 255	22 (knock-outs)	2	5	10	8*	5 x safety barriers and 3 x translators (2 x dual and 1 x single)*	

\*Note: Quantities calculated on minimum spacing required for I.S. wiring segregation

36 Brookside Road, Havant, Hampshire PO9 1JR, UK.

Tel: +44 (0)23 9249 2412

Email: sales@apollo-fire.com Fax: +44 (0)23 9249 2754 Web: www.apollo-fire.co.uk





